


J:\Withlacoochee WTP\Construction Drawings\Phase 1\00\_General\G06 FORWARD FLOW SCHEMATIC.dwg

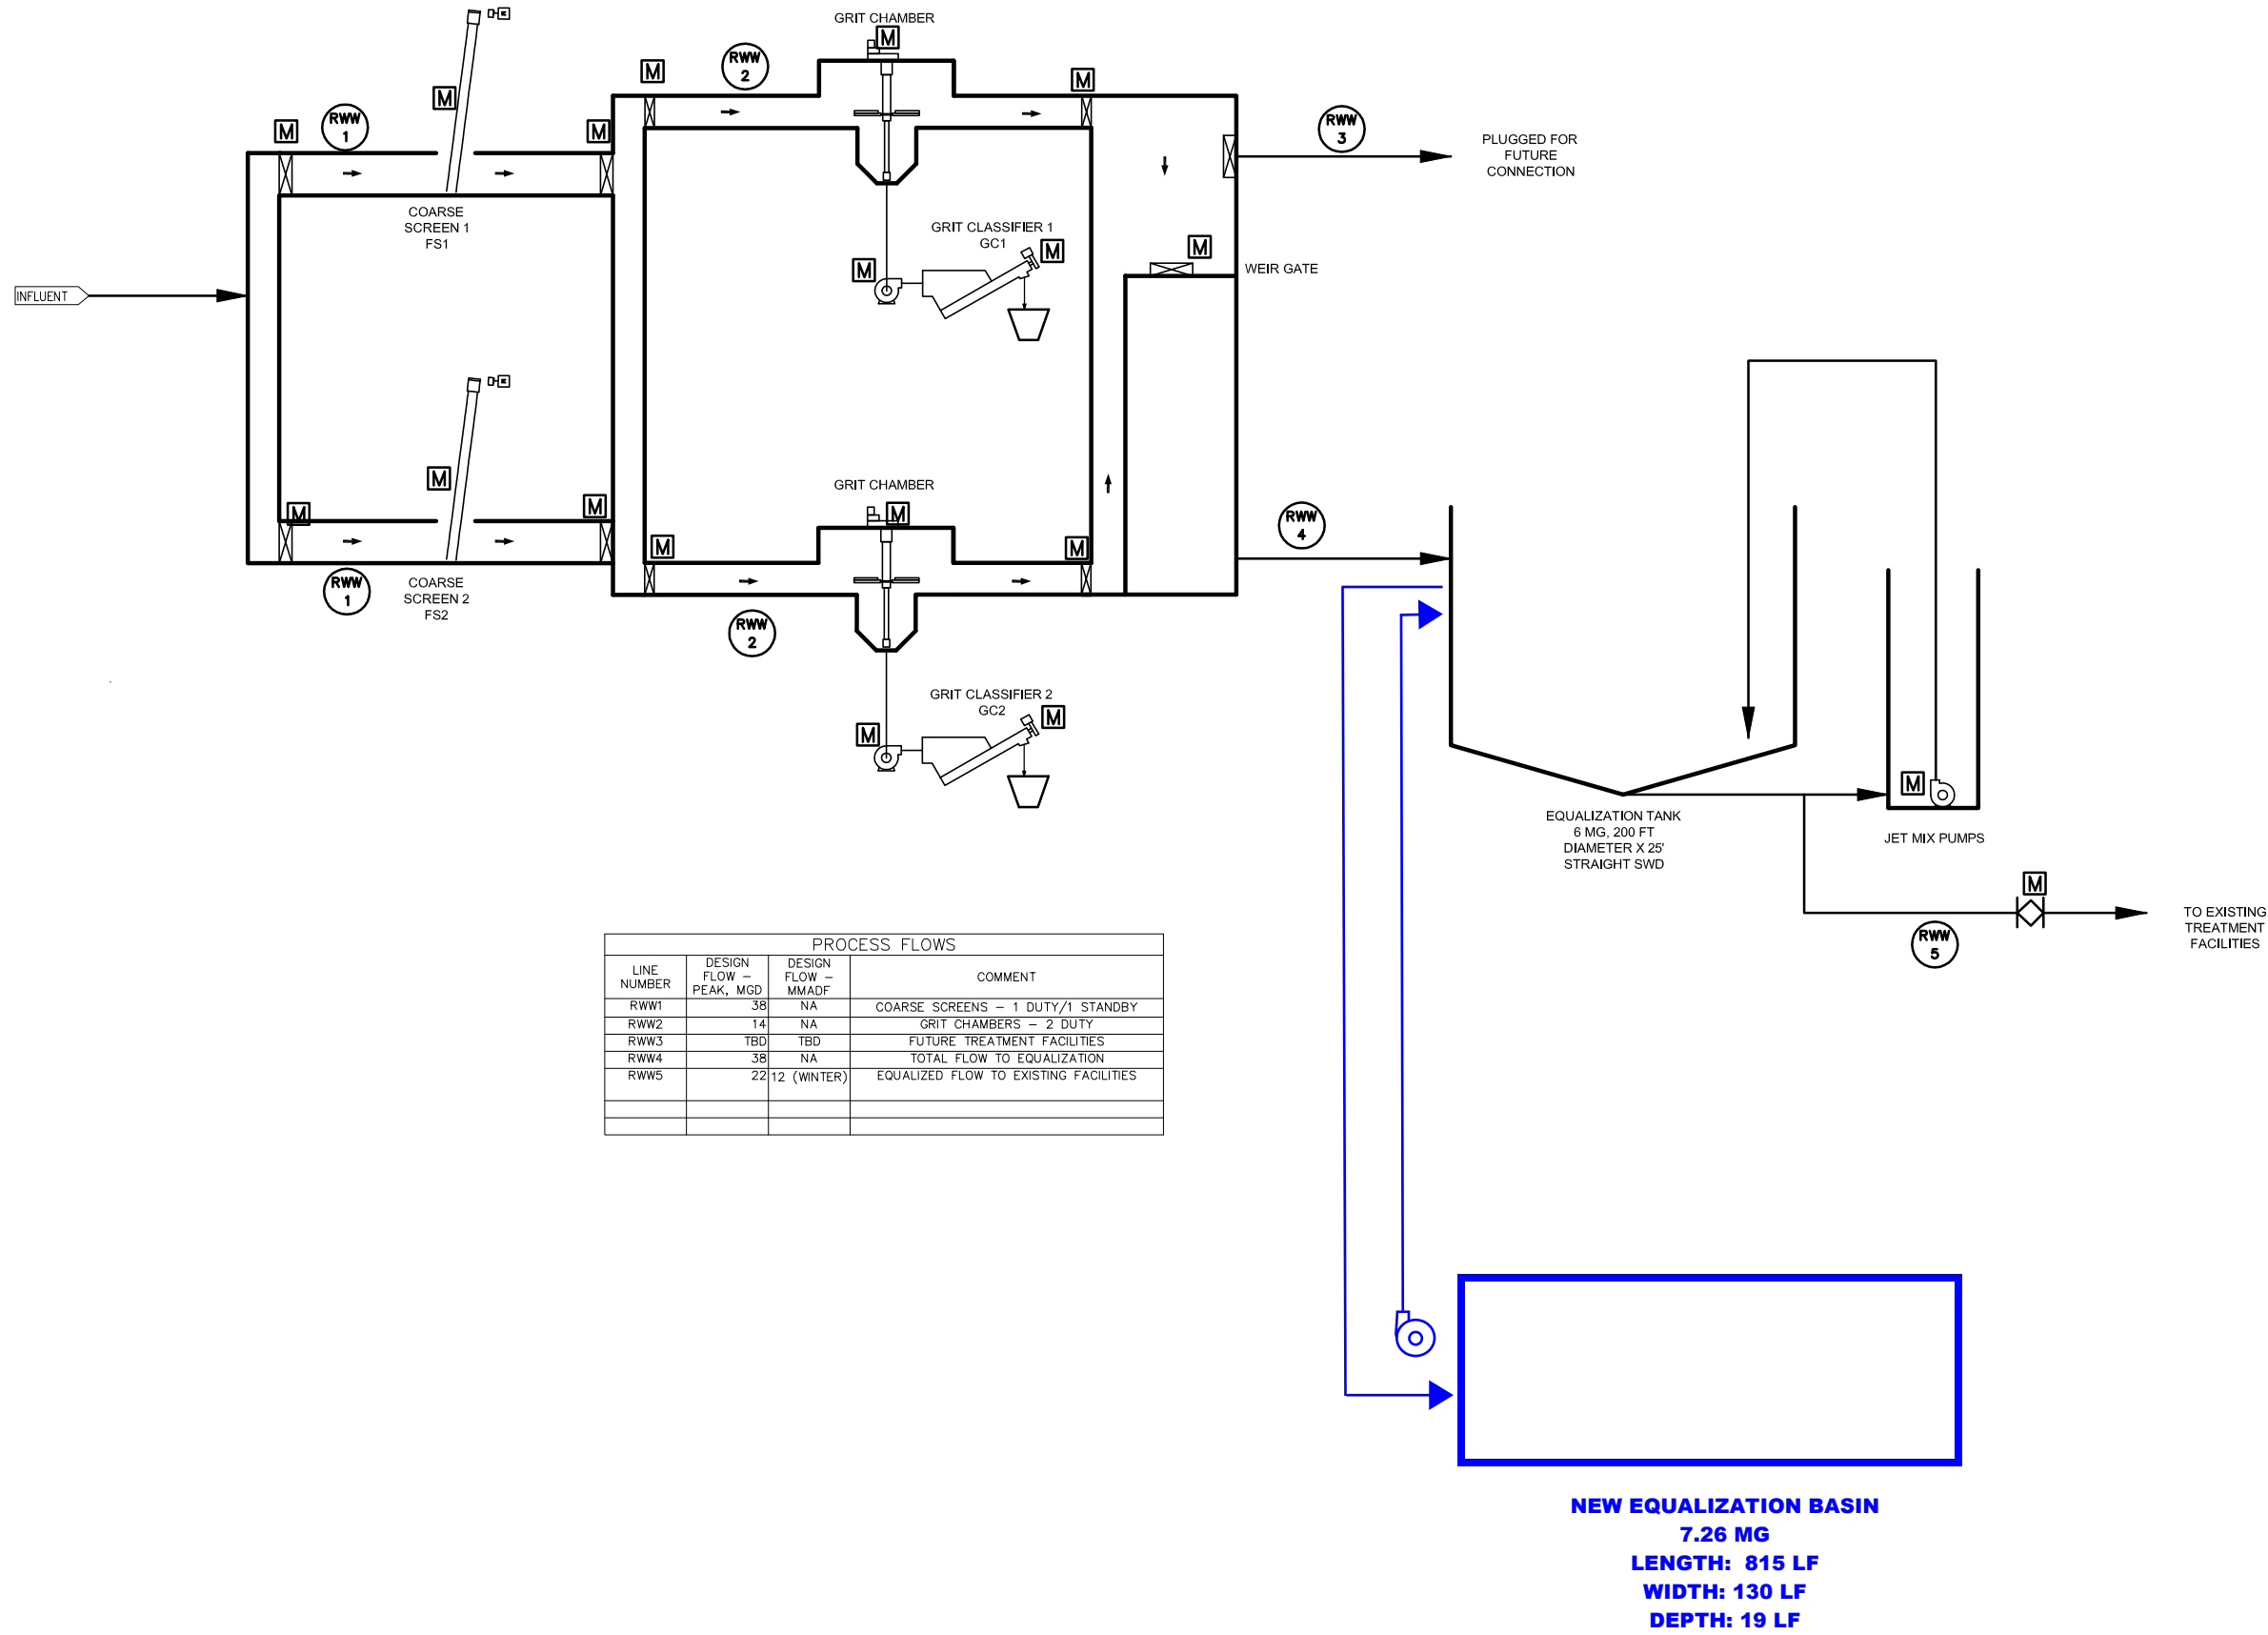

PROCESS FLOWS			
LINE NUMBER	DESIGN FLOW - PEAK, MGD	DESIGN FLOW - MMADF	COMMENT
RWW1	38	NA	COARSE SCREENS - 1 DUTY/1 STANDBY
RWW2	14	NA	GRIT CHAMBERS - 2 DUTY
RWW3	TBD	TBD	FUTURE TREATMENT FACILITIES
RWW4	38	NA	TOTAL FLOW TO EQUALIZATION
RWW5	22	12 (WINTER)	EQUALIZED FLOW TO EXISTING FACILITIES

**NEW EQUALIZATION BASIN**  
**7.26 MG**  
**LENGTH: 815 LF**  
**WIDTH: 130 LF**  
**DEPTH: 19 LF**

<p>Job No. 260384</p> <p>Designed PG</p> <p>Drawn XX</p> <p>Checked XX</p> <p>Reviewed XX</p> <p>Approved XX</p> <p>Reg. No. A</p> <p>Date 3/16/11</p>		<p>Issue Certification</p>	
<p><b>PARSONS</b>          WATER &amp; INFRASTRUCTURE INC.          357 PARKWAY LANE, SUITE 100          PHOENIX, AZ 85044-4900          PHONE: 774-468-4900          FAX: 774-468-4910</p>		<p><b>City of Valdosta</b>          UTILITIES DEPARTMENT          1016 Myrtle Street, Valdosta, GA 31603          Phone: 229-259-3592</p>	
<p>WITHLACOOCHEE WATER POLLUTION CONTROL PLANT          AND SEWER SYSTEM IMPROVEMENTS</p>		<p><b>FORWARD FLOW SCHEMATIC</b></p>	
<p>DRAWING NO. <b>G06</b></p>		<p>REV <b>0</b></p>	
<p>DATE 2/24/11 11:18:09 AM</p>		<p>DESCRIPTION DESIGN DEVELOPMENT REPORT</p>	