




**5. WATER USAGE SUMMARY**

From the estimated Facility Buildout Spring Water Consumption at Table 4.1, the product water capacity of 0.964 MGD, added with the process and potable water amount of 0.129 MGD as set forth in the Seven Springs application, the High Springs Facility buildout will require spring water at a volume of at least 1.093 MGD.

For the estimated Expected Daily Water Usage Annually at Table 4.2, shows the average line utilization at 77%. The total with process water was reduced pro rata by taking the production line usage and dividing it by .888 to add 11.2% of the total to the product water usage as set forth in the permit application. Total production water and process water usage average for estimated Expected Daily Water Usage Annually is 0.984 MGD.

Adam Thibodeau, P.E.

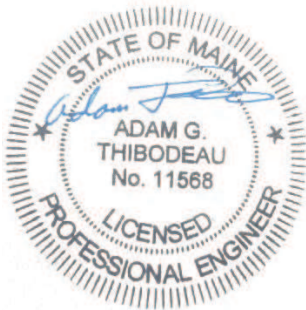

Date July 30<sup>th</sup>, 2020